


Typical Temporary Electrical Service

CITY OF GROVER BEACH

Typical Temporary Electrical Service

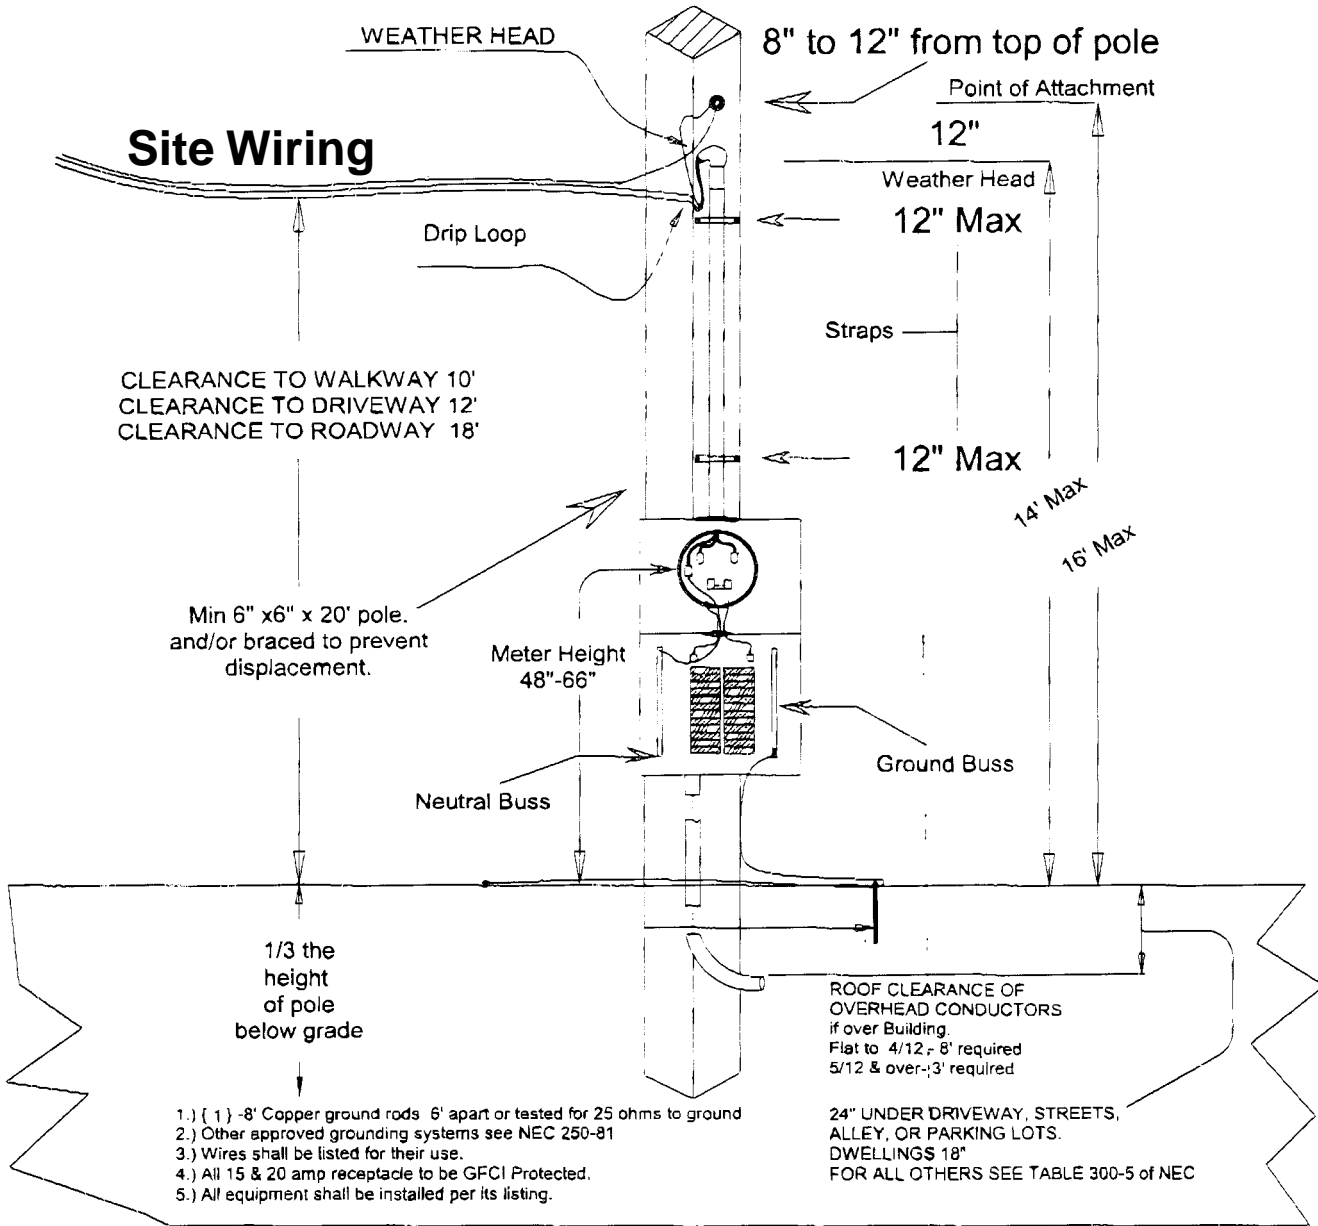

SERVICE ENTRY CONDUCTORS				
INSULATION TYPES-RH-RHH-RHW-THHW-THW-THHN-XHHW-USE				
Copper	*Alum	Amp Rating	Copper	*Alum.
#2	#1	100	#8	#4
#2	#1/0	110	#8	#4
#1	#2/0	125	#6	#2
#1/0	#3/0	150	#6	#1/0
#3/0	#250	200	#4	#1/0

* Deoxidizer Required

Ground Conductor Size

THIS SHEET IS FOR REFERENCE ONLY AND OTHER REQUIREMENTS MAY APPLY.